


Thyroid Screening

Gestation specific references ranges.		
	Second trimester	Third trimester
0.1- 2.5mU/L	0.2 - 3.0mU/L	0.3 - 3.0mU/L

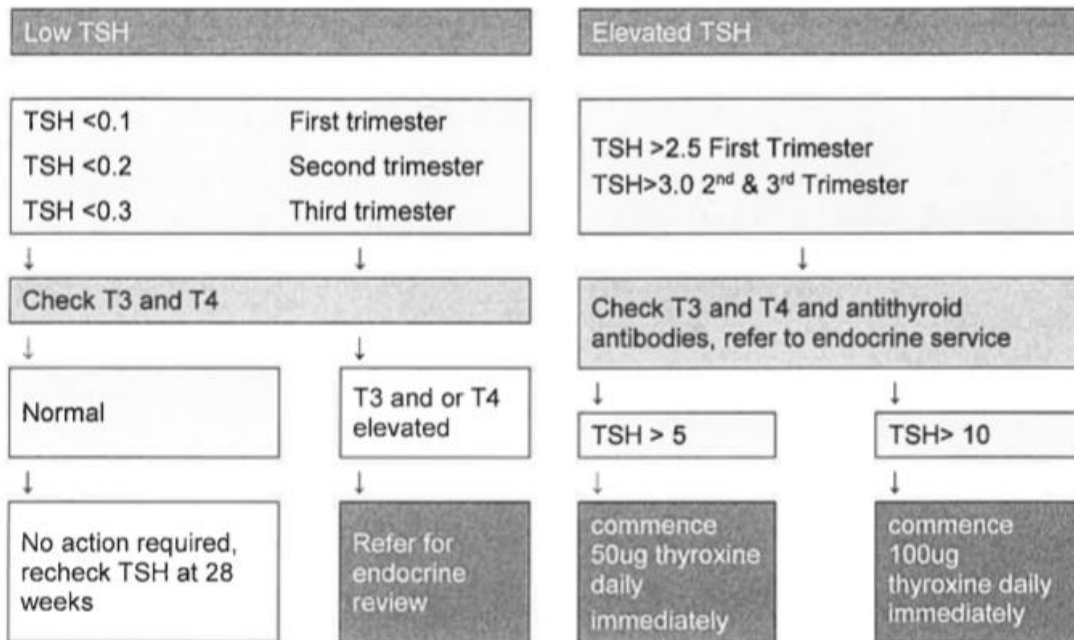

- Women with thyroid disorders should generally have their thyroid function monitored at least once each trimester.